

# **DESIGN ENVELOPE EXPRESS PUMP** 4300 |

0813-050.0 | SUBMITTAL

File No: 100.3058

Date: DECEMBER 24, 2015

Supersedes: 100.3058

Date: SEPTEMBER 22, 2015

Job:		Repres	entative:	
		Order	No:	Date:
Engineer:		Submitted by:		Date:
Contractor:		Approv	ved by:	Date:
PUMP DESIGN DATA		:	CONTROLS DATA	EXPRESS
No. of pumps:	Tag:		Sensorless Control:	N/A LANE
Capacity:USgpm (L/s) Liquid:		:	Minimum system pressure to be maintained:	ft (m)*
Temperature: °F (°C)	,	:	Orientation:	L1
	Discharge: 8" (200mr		Protocol:	BACnet <sup>TM</sup>
OSHPD Seismic Certification OSP-0422-10			Enclosure:	Indoor – UL TYPE 12
UL STD 778 & CSA STD C22.2 NO.108 certified			EMI/RFI control:	Integrated filter designed to meet EN61800-3
MOTOR DESIGN DATA			Harmonic suppression:	Dual Dc-link reactors (Equivalent: 5% AC line reactor) Supporting IEEE
HP: 50 RPM: 1800 Frame size: 326 Enclosure: ODP		•		519-1992 requirements**
Volts: ☐ 460V ☐ 575V Hertz: 60 Hz			Cooling:	Fan-cooled through back channel
Phase: 3 Efficiency: NEMA premium 12.12			Ambient temperature:	-10°C to +45°C up to 1000 meters above sea level (-14°F to +113°F, 3300 ft)
MAXIMUM PUMP OPERATING CONDITIONS		Analog ı/o:	Two current or voltage inputs, one current output	
ANSI 125  175 psig at 150°F (12 bars at 65°C)  100 psig at 300°F (7 bars at 150°C)		•	Digital ı/o:	Six programmable inputs (two can be configured as outputs)
			Pulse inputs:	Two programmable
ANSI 250			Relay outputs:	Two programmable
375 psig at 150°F (26 bars at 65°C) 260 psig at 300°F (21 bars at 150°C)		Communication port:	1-RS485, 1-USB	

\*If minimum maintained system pressure is not known: Default to 40% of design head

\*\*The IVS 102 drive is a low harmonic drive via built-in DC line reactors. This does not
guaranty performance to any system wide harmonic specification or the costs to meet
a system wide specification. If supplied with the system electrical details, Armstrong
will run a computer simulation of the system wide harmonics. If system harmonic
levels are exceeded Armstrong can also recommend additional harmonic mitigation
and the costs for such mitigation.

## MECHANICAL SEAL DESIGN DATA

certified dimensions


• Tolerance of ±0.125" (±3 mm) should be used

• For exact installation, data please write factory for

See file no. 43.50 for standard mechanical seal details as indicated below


Armstrong seal reference number: c1 (a)

2

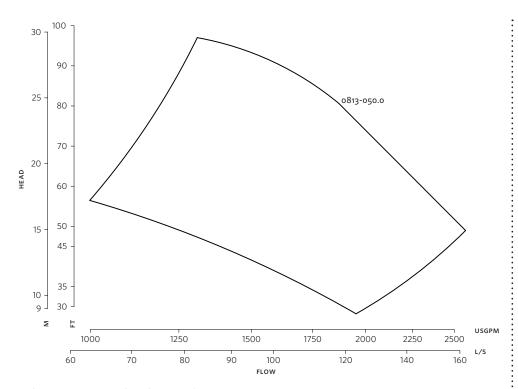

Performance curves are for reference only.

 $\label{lem:confirm} \text{Confirm current performance data with Armstrong ACE Online selection software.}$ 



# TORONTO

+1 416 755 2291

#### BUFFALO

+1 716 693 8813

# BIRMINGHAM

+44 (0) 8444 145 145

#### MANCHESTER

+44 (0) 8444 145 145

## BANGALORE

+91 (0) 80 4906 3555

### SHANGHAI

+86 21 3756 6696

ARMSTRONG FLUID TECHNOLOGY ESTABLISHED 1934

#### **DIMENSION DATA**

	INDOOR (UL TYPE 12/ODP)
Frame size:	326
Size:	8×8×13
HP:	50

**RPM:** 1800 **AB:** 48.77(1239) **B:** 12.00(305)

**c:** 9.75(248)

**D:** 19.00(483)

**E:** 20.70(526)

**P:** 14.13(359)

**F:** 43.70(1110)

**s:** 23.00(584)

**sp:** 42.00(1067)

**T:** 9.94(252)

**xy:** 44.15(1121) **Weight:** 1344(609.6)

Dimensions - inch (mm) Weight - lbs (kg)

